

SLIP RESISTANCE  
TEST REPORT




Project : Slip Resistance Investigation  
 Location of Test : Auckland Laboratory  
 Client : Advance Landscape Systems Ltd  
 Slider type : FOUR-S/Slider 96, Prepared on P 400 (or equivalent) sand paper & Lapping Film  
 Specimen Description : Anti-Slip Mesh on Plywood (1004x1004)mm  
 Cleaning Procedure : Wet Brush  
 Test Type : Unfixed  
 Air Temp at Test (°C) : 16.4  
 Tested By : Abaid Nagimi  
 Tested Date : 12/09/22

Project Number : 1-LA657.00  
 Lab Ref. Number : AL8103/1  
 Client Ref. Number : -

SLIP RESISTANCE TEST RESULTS			
Specimen Nº :	Test Direction :	Mean BPN :	Mean Coefficient of Friction* :
1	N/A	43	0.45
2		48	0.51
3		49	0.52
4		50	0.54
5		45	0.47
Average SRV :		47	0.50
Classification of pedestrian surface material in accordance with table 2, AS 4586:2013 :			P4

**TEST METHOD**  
 Tests were carried out in accordance with Appendix A, AS 4586:2013, the classification is based on a test in the wet condition.  
 \*Coefficient of friction obtained from: AS/NZS 3661.1 : 1993 Slip Resistance of Pedestrian Surfaces.  
 One sample tested.

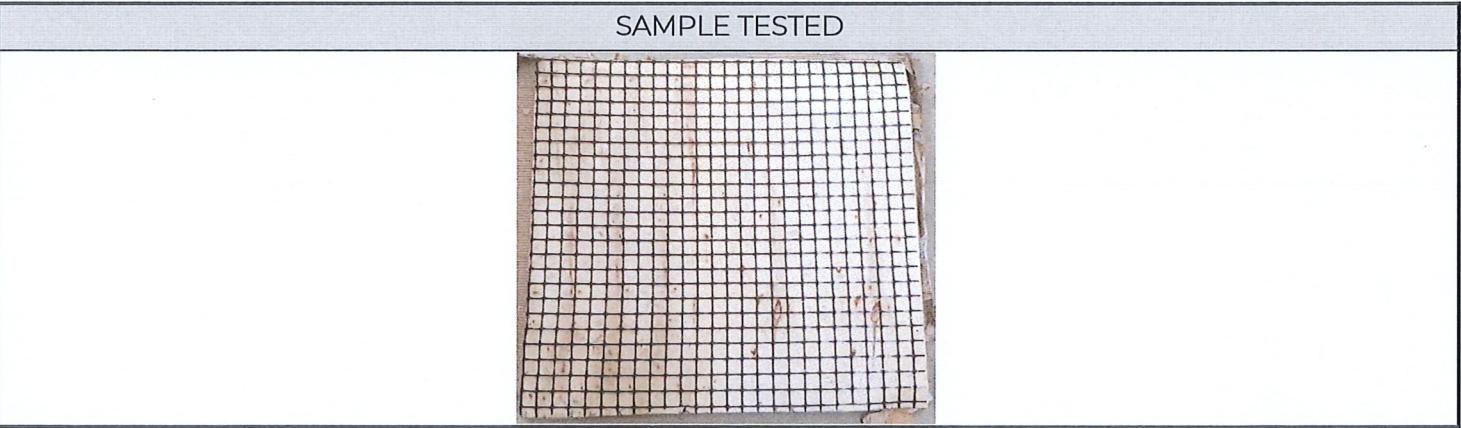

Approved By :  Glen Sandford  
 Designation : Senior Civil Engineering Technician  
 Date Approved : 13/09/22